



CLIENTS | PEOPLE | PERFORMANCE

Toilets by Tennis Courts, Rawhiti Domain  
PRK 2004 BLDG 002 EQ2  
Detailed Engineering Evaluation  
Qualitative Report  
Version FINAL

35 – 37 Bowhill Road

**Toilets by Tennis Courts, Rawhiti Domain  
PRK 2004 BLDG 002 EQ2**

Detailed Engineering Evaluation  
Qualitative Report  
Version FINAL

35 – 37 Bowhill Road

Christchurch City Council

**Prepared By**  
Paul Clarke

**Reviewed By**  
Alex Baylis

**Date**  
07<sup>th</sup> March 2013

# Contents

Qualitative Report Summary	iii
1. Background	1
2. Compliance	2
2.1 Canterbury Earthquake Recovery Authority (CERA)	2
2.2 Building Act	3
2.3 Christchurch City Council Policy	4
2.4 Building Code	4
3. Earthquake Resistance Standards	5
4. Building Description	7
4.1 General	7
4.2 Gravity Load Resisting System	8
4.3 Lateral Load Resisting System	8
5. Assessment	9
6. Damage Assessment	10
6.1 Surrounding Buildings	10
6.2 Residual Displacements and General Observations	10
6.3 Ground Damage	10
7. Critical Structural Weakness	11
7.1 Short Columns	11
7.2 Lift Shaft	11
7.3 Roof	11
7.4 Staircases	11
7.5 Site Characteristics	11
7.6 Unrestrained Masonry Panels	11
8. Geotechnical Consideration	12
8.1 Site Description	12
8.2 Published Information on Ground Conditions	12
8.3 Seismicity	13

8.4	Slope Failure and/or Rockfall Potential	14
8.5	Liquefaction Potential	14
8.6	Conclusions & Recommendations	14
9.	Survey	16
10.	Initial Capacity Assessment	17
10.1	% NBS Assessment	17
10.2	Seismic Parameters	17
10.3	Expected Structural Ductility Factor	17
10.4	Discussion of Results	17
11.	Initial Conclusions	18
12.	Recommendations	19
13.	Limitations	20
13.1	General	20
13.2	Geotechnical Limitations	20

## Table Index

Table 1	%NBS compared to relative risk of failure	6
Table 2	ECan Borehole Summary	12
Table 3	Summary of Known Active Faults	14

## Figure Index

Figure 1	NZSEE Risk Classifications Extracted from table 2.2 of the NZSEE 2006 AISPBE	5
Figure 2	Plan Sketch Showing Key Structural Elements	7
Figure 3	Post February 2011 Earthquake Aerial Photography	13

## Appendices

- A Photographs
- B Existing Drawings / Sketches
- C CERA Building Evaluation Form

# Qualitative Report Summary

**Toilet by Tennis Courts, Rawhiti Domain**

**PRK 2004 BLDG 002 EQ2**

**Detailed Engineering Evaluation**

**Qualitative Report - SUMMARY**

**Version FINAL**

**35 – 37 Bowhill Road**

## **Background**

This is a summary of the Qualitative report for the building structure, and is based in part on the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011 and visual inspections on 18<sup>th</sup> June 2012.

## **Building Description**

The building roof is formed from curved steel corrugate sheets on a rigid steel tube purlin and truss frame. The roof frame has steel tube columns extending to foundations at each corner, however each truss is individually supported by steel tubes extending into the 15 series partial fill external masonry walls. Wall construction is consistent throughout. The floor is most likely formed by a slab on grade.

## **Key Damage Observed**

No damage of the structure was observed.

## **Critical Structural Weaknesses**

No potential critical structural weaknesses were observed in the structure, however the identification of unrestrained masonry panels at the entrances to the toilets, while not having a significant effect on overall structural performance of the building, it does have implications for possible threat to life. Accordingly, a compensating provision for a 'significant' potential threat to life has been incorporated in Factor F, in accordance with the NZSEE guidelines.

## **Indicative Building Strength (from IEP and CSW assessment)**

Based on the information available, and using the NZSEE Initial Evaluation Procedure, the original capacity of the building has been assessed to be in the order of 39% NBS and post-earthquake capacity also in the order of 39% NBS. The buildings post-earthquake capacity excluding critical structural weaknesses or design weaknesses is in the order of 55% NBS.

The building has been assessed to have a seismic capacity in the order of 39% NBS and is therefore not potentially Earthquake Prone.

## **Recommendations**

It is recommended that:

- The building has not been assessed as being potentially Earthquake Prone.
- CCC are not required to undertake a detailed seismic assessment, however due to the relatively low score, GHD recommend a detailed seismic assessment is carried out.

# 1. Background

GHD has been engaged by the Christchurch City Council (CCC) to undertake a detailed engineering evaluation of the Toilet by Tennis Courts, Rawhiti Domain.

This report is a Qualitative Assessment of the building structure, and is based in part on the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011.

A qualitative assessment involves inspections of the building and a desktop review of existing structural and geotechnical information, including existing drawings and calculations, if available.

The purpose of the assessment is to determine the likely building performance and damage patterns, to identify any potential critical structural weaknesses or collapse hazards, and to make an initial assessment of the likely building strength in terms of percentage of new building standard (%NBS).

At the time of this report, no intrusive site investigation, detailed analysis, or modelling of the building structure had been carried out. Construction drawings were made available, and these have been considered in our evaluation of the building. The building description below is based on a review of the drawings and our visual inspections.

## 2. Compliance

This section contains a brief summary of the requirements of the various statutes and authorities that control activities in relation to buildings in Christchurch at present.

### 2.1 Canterbury Earthquake Recovery Authority (CERA)

CERA was established on 28 March 2011 to take control of the recovery of Christchurch using powers established by the Canterbury Earthquake Recovery Act enacted on 18 April 2011. This act gives the Chief Executive Officer of CERA wide powers in relation to building safety, demolition and repair. Two relevant sections are:

#### **Section 38 – Works**

This section outlines a process in which the chief executive can give notice that a building is to be demolished and if the owner does not carry out the demolition, the chief executive can commission the demolition and recover the costs from the owner or by placing a charge on the owners' land.

#### **Section 51 – Requiring Structural Survey**

This section enables the chief executive to require a building owner, insurer or mortgagee carry out a full structural survey before the building is re-occupied.

We understand that CERA will require a detailed engineering evaluation to be carried out for all buildings (other than those exempt from the Earthquake Prone Building definition in the Building Act). It is anticipated that CERA will adopt the Detailed Engineering Evaluation Procedure document (draft) issued by the Structural Advisory Group on 19 July 2011. This document sets out a methodology for both qualitative and quantitative assessments.

The qualitative assessment is a desk-top and site inspection assessment. It is based on a thorough visual inspection of the building coupled with a review of available documentation such as drawings and specifications. The quantitative assessment involves analytical calculation of the buildings strength and may require non-destructive or destructive material testing, geotechnical testing and intrusive investigation.

It is anticipated that factors determining the extent of evaluation and strengthening level required will include:

- ▶ The importance level and occupancy of the building
- ▶ The placard status and amount of damage
- ▶ The age and structural type of the building
- ▶ Consideration of any critical structural weaknesses
- ▶ The extent of any earthquake damage

## **2.2 Building Act**

Several sections of the Building Act are relevant when considering structural requirements:

### **Section 112 – Alterations**

This section requires that an existing building complies with the relevant sections of the Building Code to at least the extent that it did prior to any alteration. This effectively means that a building cannot be weakened as a result of an alteration (including partial demolition).

### **Section 115 – Change of Use**

This section requires that the territorial authority (in this case Christchurch City Council (CCC)) be satisfied that the building with a new use complies with the relevant sections of the Building Code 'as near as is reasonably practicable'. Regarding seismic capacity 'as near as reasonably practicable' has previously been interpreted by CCC as achieving a minimum of 67% NBS however where practical achieving 100% NBS is desirable. The New Zealand Society for Earthquake Engineering (NZSEE) recommend a minimum of 67% NBS.

#### **2.2.1 Section 121 – Dangerous Buildings**

The definition of dangerous building in the Act was extended by the Canterbury Earthquake (Building Act) Order 2010, and it now defines a building as dangerous if:

- ▶ In the ordinary course of events (excluding the occurrence of an earthquake), the building is likely to cause injury or death or damage to other property; or
- ▶ In the event of fire, injury or death to any persons in the building or on other property is likely because of fire hazard or the occupancy of the building; or
- ▶ There is a risk that the building could collapse or otherwise cause injury or death as a result of earthquake shaking that is less than a 'moderate earthquake' (refer to Section 122 below); or
- ▶ There is a risk that that other property could collapse or otherwise cause injury or death; or
- ▶ A territorial authority has not been able to undertake an inspection to determine whether the building is dangerous.

### **Section 122 – Earthquake Prone Buildings**

This section defines a building as earthquake prone if its ultimate capacity would be exceeded in a 'moderate earthquake' and it would be likely to collapse causing injury or death, or damage to other property. A moderate earthquake is defined by the building regulations as one that would generate ground shaking 33% of the shaking used to design an equivalent new building.

### **Section 124 – Powers of Territorial Authorities**

This section gives the territorial authority the power to require strengthening work within specified timeframes or to close and prevent occupancy to any building defined as dangerous or earthquake prone.

### **Section 131 – Earthquake Prone Building Policy**

This section requires the territorial authority to adopt a specific policy for earthquake prone, dangerous and insanitary buildings.

## **2.3 Christchurch City Council Policy**

Christchurch City Council adopted their Earthquake Prone, Dangerous and Insanitary Building Policy in 2006. This policy was amended immediately following the Darfield Earthquake of the 4th September 2010.

The 2010 amendment includes the following:

- ▶ A process for identifying, categorising and prioritising Earthquake Prone Buildings, commencing on 1 July 2012;
- ▶ A strengthening target level of 67% of a new building for buildings that are Earthquake Prone;
- ▶ A timeframe of 15-30 years for Earthquake Prone Buildings to be strengthened; and,
- ▶ Repair works for buildings damaged by earthquakes will be required to comply with the above.

The council has stated their willingness to consider retrofit proposals on a case by case basis, considering the economic impact of such a retrofit.

We anticipate that any building with a capacity of less than 33% NBS (including consideration of critical structural weaknesses) will need to be strengthened to a target of 67% NBS of new building standard as recommended by the Policy.

If strengthening works are undertaken, a building consent will be required. A requirement of the consent will require upgrade of the building to comply 'as near as is reasonably practicable' with:

- ▶ The accessibility requirements of the Building Code.
- ▶ The fire requirements of the Building Code. This is likely to require a fire report to be submitted with the building consent application.

## **2.4 Building Code**

The building code outlines performance standards for buildings and the Building Act requires that all new buildings comply with this code. Compliance Documents published by The Department of Building and Housing can be used to demonstrate compliance with the Building Code.

After the February Earthquake, on 19 May 2011, Compliance Document B1: Structure was amended to include increased seismic design requirements for Canterbury as follows:

- ▶ Hazard Factor increased from 0.22 to 0.3 (36% increase in the basic seismic design load)
- ▶ Serviceability Return Period Factor increased from 0.25 to 0.33 (80% increase in the serviceability design loads when combined with the Hazard Factor increase)

The increase in the above factors has resulted in a reduction in the level of compliance of an existing building relative to a new building despite the capacity of the existing building not changing.

### 3. Earthquake Resistance Standards

For this assessment, the building's earthquake resistance is compared with the current New Zealand Building Code requirements for a new building constructed on the site. This is expressed as a percentage of new building standard (%NBS). The new building standard load requirements have been determined in accordance with the current earthquake loading standard (NZS 1170.5:2004 Structural design actions - Earthquake actions - New Zealand).

The likely capacity of this building has been derived in accordance with the New Zealand Society for Earthquake Engineering (NZSEE) guidelines 'Assessment and Improvement of the Structural Performance of Buildings in Earthquakes' (AISPBE), 2006. These guidelines provide an Initial Evaluation Procedure that assesses a buildings capacity based on a comparison of loading codes from when the building was designed and currently. It is a quick high-level procedure that can be used when undertaking a Qualitative analysis of a building. The guidelines also provide guidance on calculating a modified Ultimate Limit State capacity of the building which is much more accurate and can be used when undertaking a Quantitative analysis.

The New Zealand Society for Earthquake Engineering has proposed a way for classifying earthquake risk for existing buildings in terms of %NBS and this is shown in Figure 1 below.

Description	Grade	Risk	%NBS	Existing Building Structural Performance	Improvement of Structural Performance	
					Legal Requirement	NZSEE Recommendation
Low Risk Building	A or B	Low	Above 67	Acceptable (improvement may be desirable)	The Building Act sets no required level of structural improvement (unless change in use) This is for each TA to decide. Improvement is not limited to 34%NBS.	100%NBS desirable. Improvement should achieve at least 67%NBS
Moderate Risk Building	B or C	Moderate	34 to 66	Acceptable legally. Improvement recommended		Not recommended. Acceptable only in exceptional circumstances
High Risk Building	D or E	High	33 or lower	Unacceptable (Improvement)	Unacceptable	Unacceptable

**Figure 1 NZSEE Risk Classifications Extracted from table 2.2 of the NZSEE 2006 AISPBE**

Table 1 compares the percentage NBS to the relative risk of the building failing in a seismic event with a 10% risk of exceedance in 50 years (i.e. 0.2% in the next year). It is noted that the current seismic risk in Christchurch results in a 6% risk of exceedance in the next year.

Percentage of New Building Standard (%NBS)	Relative Risk (Approximate)
>100	<1 time
80-100	1-2 times
67-80	2-5 times
33-67	5-10 times
20-33	10-25 times
<20	>25 times


**Table 1 %NBS compared to relative risk of failure**

## 4. Building Description

### 4.1 General

The building is located at 35 – 37 Bowhill Road, New Brighton. The building's construction date is estimated to 1980's and sole use is a public toilet.

The building roof is formed from curved steel corrugate sheets on a rigid steel tube purlin and truss frame. The roof frame has steel tube columns extending to foundations at each corner, however each truss is individually supported by steel tubes extending into the 15 series partial fill external masonry walls. Wall construction is consistent throughout. The floor is most likely formed by a slab on grade.

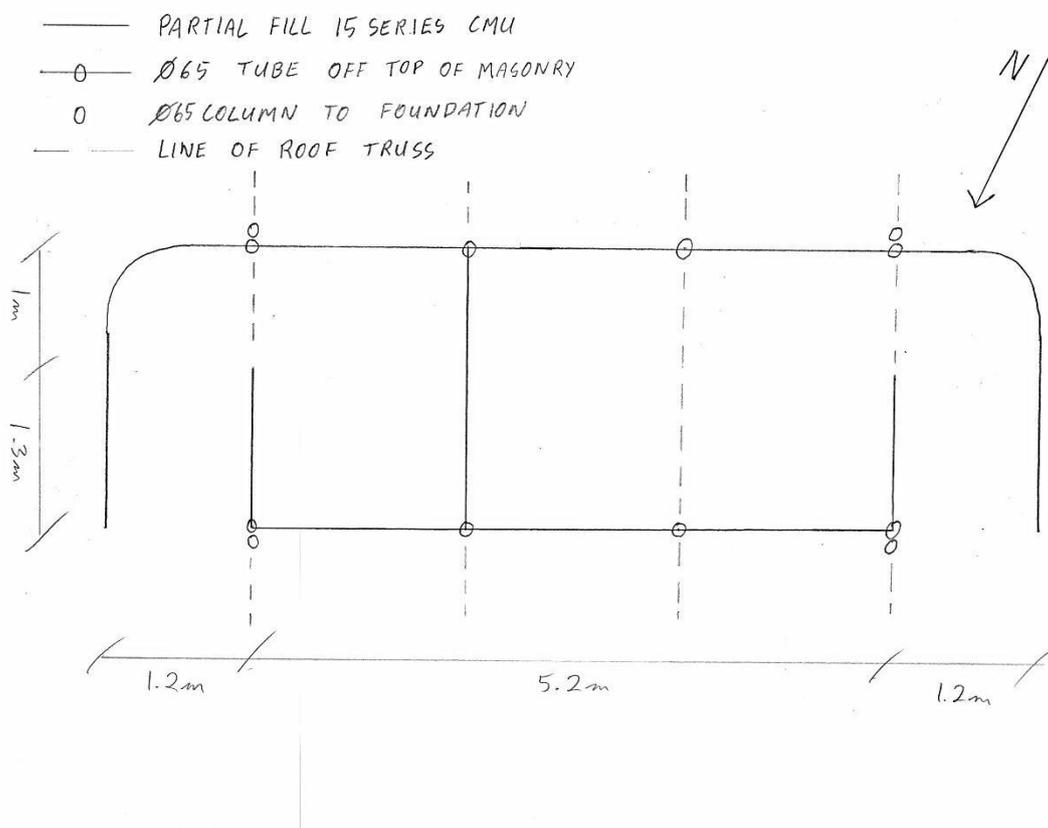

**Figure 2 Plan Sketch Showing Key Structural Elements**

Excluding entrance wing walls, the roofed structure is approximately 5.2m in length and 2.3m in width with a height of 3.4m. The building occupies an approximate footprint of 12m<sup>2</sup> and is located over 20m from the nearest structure. The flat site is situated 500m west of the coast and 800m north of Avon River, and consists of many public amenities including golf course, oval, athletic track, tennis courts, club house and playground.

No plans were available for this structure.

## **4.2 Gravity Load Resisting System**

Gravity roof loads are transferred through the purlin and truss frame to external load bearing walls, which in turn transfer the loads to the raft slab and grade beneath. Steel tube posts are present at each corner of the roof structure, however these posts are expected to support little or none of the gravity loads.

## **4.3 Lateral Load Resisting System**

Lateral loads are resisted by the panel action of the partially filled concrete masonry walls in the plane of loading.

In the longitudinal direction, lateral loads on the roof are transferred by the frame action of the roof structure to walls in the plane of loading. These walls in turn resist the lateral loads by the panel action of masonry and transfer the loads to the foundation.

Similarly in the transverse direction, lateral loads on the roof are transferred by the frame action of the roof structure to walls in the plane of loading. These walls in turn resist the lateral loads by the panel action of masonry and transfer the loads to the foundation.

Out of plane loads to wall panels are resisted by the panel spanning horizontally between adjacent perpendicular walls, which in turn transfer the loads to the ground by the panel action of masonry.

## 5. Assessment

An inspection of the building was undertaken on the 18<sup>th</sup> June 2012. Both the interior and exterior of the building were inspected.

The inspection consisted of scrutinising the building to determine the structural systems and likely behaviour of the building during an earthquake. The site was assessed for damage, including examination of the ground conditions, checking for damage in areas where damage would be expected for the type of structure and noting general damage observed throughout the building in both structural and non-structural elements.

The %NBS score determined for this building has been based on the IEP procedure described by the NZSEE and based on the information obtained from visual observation of the building and available drawings.

## 6. Damage Assessment

### 6.1 Surrounding Buildings

The only buildings located nearby were constructed post-earthquake.

### 6.2 Residual Displacements and General Observations

No residual displacements of the structure were noticed during our inspection of the building.

### 6.3 Ground Damage

There was no evidence of ground damage on the property or surrounding neighbours land.

## 7. Critical Structural Weakness

### 7.1 Short Columns

No short columns are present in the structure.

### 7.2 Lift Shaft

The building does not contain a lift shaft.

### 7.3 Roof

The roof structure was formed by rigidly connected steel tube purlins and trusses, forming a stable braced structure.

### 7.4 Staircases

The building does not contain a staircase.

### 7.5 Site Characteristics

Presence of sands and silts allow for liquefaction potential though no liquefaction have been observed, this coupled with a minimal potential effect on structural performance due to structural type, dictates a 'insignificant' site characteristic in accordance with the NZSEE guidelines.

### 7.6 Unrestrained Masonry Panels

Unrestrained masonry panels were identified in the structure at the entrances to the toilets, while not having a significant effect on overall structural performance of the building, it does have implications for possible threat to life. Accordingly, a compensating provision for a 'significant' potential threat to life has been incorporated in Factor F, in accordance with the NZSEE guidelines.

## 8. Geotechnical Consideration

### 8.1 Site Description

The three individual sites are situated within a recreational domain, within the suburb of New Brighton in eastern Christchurch. It is relatively flat at approximately 3m above mean sea level. It is situated 500 m from the coast line (Pegasus Bay), approximately 800 m north of the Avon River.

### 8.2 Published Information on Ground Conditions

#### 8.2.1 Published Geology

The geological map of the area<sup>1</sup> indicates that the site is underlain by Holocene marine/estuarine soils of the Christchurch Formation, comprising dominantly of sand of fixed and semi-fixed dunes and beaches.

#### 8.2.2 Environment Canterbury Logs

Information from Environment Canterbury (ECan) indicates that ten boreholes are located within a 200m radius of the site (see Table 2). Of these boreholes, two of them had lithographic logs that indicate the area is typically clays and sand with some peat layers between 30 and 40m bgl. Varying amounts of gravel is also indicated to be present. Groundwater was encountered between 1.65 and 5.2 m bgl.

**Table 2 ECan Borehole Summary**

Bore Name	Log Depth	Groundwater	Distance from Site
M35/2388	84.7m	5.2m bgl	200 m
M35/2443	104.2m	3.66m bgl	200m

It should be noted that the boreholes were sunk for groundwater extraction and not for geotechnical purposes' therefore, the amount of material recovered and available for interpretation and recording will have been variable at best and may not be representative. The logs have been written by the well driller and not a geotechnical professional or to a standard. In addition strength data is not recorded.

#### 8.2.3 EQC Geotechnical Investigations

The Earthquake Commission has not undertaken geotechnical testing within 500m of the subject site.

#### 8.2.4 Land Zoning

Canterbury Earthquake Recovery Authority (CERA) has indicated the site is situated within the Green Zone, indicating that repair and rebuild may take place.

Land in the CERA green zone has been divided into three technical categories TC1 (grey), TC2 (yellow) and TC3 (blue). These categories describe how the land is expected to perform in future earthquakes.

<sup>1</sup> Brown, L. J. and Weeber, J.H. 1992: Geology of the Christchurch Urban Area. Institute of Geological and Nuclear Sciences 1:25,000 Geological Map 1. Lower Hutt. Institute of Geological and Nuclear Sciences Limited.

The site is classified as NA - Urban Nonresidential however, residential properties surrounding the site have been categorised TC2 (Yellow).

### 8.2.5 Post February Aerial Photography

Aerial photography taken following the 22 February 2011 earthquake shows no signs of liquefaction outside the building footprint or adjacent to the site, as shown in Figure 3.

**Figure 3 Post February 2011 Earthquake Aerial Photography <sup>2</sup>**



### 8.2.6 Summary of Ground Conditions

From the information presented above, the ground conditions underlying the site are anticipated to comprise multiple strata of clay and sand with varying peat layers and gravel.

## 8.3 Seismicity

### 8.3.1 Nearby Faults

There are many faults in the Canterbury region, however only those considered most likely to have an adverse effect on the site are detailed below.

<sup>2</sup> Aerial Photography Supplied by Koordinates sourced from <http://koordinates.com/layer/3185-christchurch-post-earthquake-aerial-photos-24-feb-2011/>

**Table 3 Summary of Known Active Faults<sup>34</sup>**

Known Active Fault	Distance from Site	Direction from Site	Max Magnitude	Likely	Avg Recurrence Interval
Alpine Fault	130 km	NW	~8.3		~300 years
Greendale (2010) Fault	29 km	W	7.1		~15,000 years
Hope Fault	110 km	N	7.2~7.5		120~200 years
Kelly Fault	110 km	NW	7.2		~150 years
Porters Pass Fault	70 km	NW	7.0		~1100 years

Recent earthquakes since 04 September 2010 have identified the presence of a previously unmapped active fault system underneath the Canterbury Plains, extending beneath Christchurch City and the Port Hills. Research and published information on this system is in development and not generally available. Average recurrence intervals are yet to be estimated.

### 8.3.2 Ground Shaking Hazard

New Zealand Standard NZS 1170.5:2004 quantifies the Seismic Hazard factor for Christchurch as 0.30, being in a moderate to high earthquake zone. This value has been provisionally upgraded recently (from 0.22) to reflect the seismicity hazard observed in the earthquakes since 4 September 2010.

The recent seismic activity has produced earthquakes of Magnitude-6.3 with peak ground accelerations (PGA) up to twice the acceleration due to gravity (2g) in some parts of the city. This has resulted in widespread liquefaction throughout Christchurch.

### 8.4 Slope Failure and/or Rockfall Potential

Given the site's location in New Brighton, a flat suburb in eastern Christchurch, global slope instability is considered negligible. However, any localised retaining structures or embankments should be further investigated to determine the site-specific slope instability potential.

### 8.5 Liquefaction Potential

Due to the presence of marine and alluvial deposits, liquefaction is considered possible where sands and silts are present. However, evidence from the post-earthquake aerial photography shows no signs of liquefaction.

### 8.6 Conclusions & Recommendations

This assessment is based on a review of the geology and existing ground investigation information, and observations from the Christchurch earthquakes since 4 September 2010.

<sup>3</sup> Stirling, M.W., McVerry, G.H. and Berryman K.R. (2002) A New Seismic Hazard Model for New Zealand, Bulletin of the Seismological Society of America, Vol. 92 No. 5, pp 1878-1903, June 2002.

<sup>4</sup> GNS Active Faults Database

The site appears to be situated on stratified marine and alluvial deposits, comprising clay, sand and gravel. Associated with this, the site also has a low to moderate liquefaction potential, in particular where sands are present.

A soil class of **D** (in accordance with NZS 1170.5:2004) should be adopted for the site. Should a more comprehensive liquefaction and/or ground condition assessment be required, it is recommended that intrusive investigation be conducted. Specific testing details can be provided upon commission of the quantitative assessment phase.

## 9. Survey

No level or verticality surveys have been undertaken for this building at this stage as indicated by Christchurch City Council guidelines.

## 10. Initial Capacity Assessment

### 10.1 % NBS Assessment

The building has had its capacity assessed using the Initial Evaluation Procedure based on the information available. The buildings capacity excluding design weaknesses is to the order of 55% NBS, once the capacity reduction of any identified weaknesses are included, the percentage of new building standard is in the order of 39% NBS.

Following an IEP assessment, the building has been assessed as achieving 39% New Building Standard (NBS). Under the New Zealand Society for Earthquake Engineering (NZSEE) guidelines the building is considered Earthquake Risk as it achieves greater than 33% and less than 67% NBS. This score has not been adjusted when considering damage to the structure as all damage observed was relatively minor and considered unlikely to adversely affect the load carrying capacity of the structural systems.

### 10.2 Seismic Parameters

The seismic design parameters based on current design requirements from NZS 1170:2002 and the NZBC clause B1 for this building are:

- ▶ Site soil class: D, NZS 1170.5:2004, Clause 3.1.3, Soft Soil
- ▶ Site hazard factor,  $Z = 0.3$ , NZBC, Clause B1 Structure, Amendment 11 effective from 1 August 2011
- ▶ Return period factor  $R_u = 1.0$ , NZS 1170.5:2004, Table 3.5, Importance level 2 structure with a 50 year design life.

An increased  $Z$  factor of 0.3 for Christchurch has been used in line with requirements from the Department of Building and Housing resulting in a reduced % NBS score.

### 10.3 Expected Structural Ductility Factor

A structural ductility factor of 1.25 has been assumed based on the concrete masonry wall system observed and the date of construction. The concrete masonry walls are expected to be nominally ductile as the units are partially filled and likely to be lightly reinforced.

### 10.4 Discussion of Results

The results obtained from the initial IEP assessment are consistent with those expected for a building of this age and construction type. Although the exact date is unknown, it is estimated as a 1980's construction and was likely designed to the loading standard current at the time, NZS 4203:1976. The design loads used in accordance with this standard are likely to have been less than those required by the current loading standard. When combined with the increase in the hazard factor for Christchurch to 0.3, it would be expected that the building would achieve a %NBS significantly lower than that of a new structure. A further reduction to the %NBS has been applied due to the design defect of unrestrained masonry panels and it is reasonable to expect the building to be classified as potentially Earthquake Risk.

## 11. Initial Conclusions

The building has been assessed to have a seismic capacity in the order of 39% NBS and is therefore not potentially Earthquake Prone.

## 12. Recommendations

The building has been assessed as not being potentially Earthquake Prone.

CCC are not required to undertake a detailed seismic assessment, however due to the relatively low score, GHD recommend a detailed seismic assessment is carried out.

## 13. Limitations

### 13.1 General

This report has been prepared subject to the following limitations:

- ▶ No intrusive structural investigations have been undertaken.
- ▶ No intrusive geotechnical investigations have been undertaken.
- ▶ No level or verticality surveys have been undertaken.
- ▶ No material testing has been undertaken.
- ▶ No calculations, other than those included as part of the IEP in the CERA Building Evaluation Report, have been undertaken. No modelling of the building for structural analysis purposes has been performed.

It is noted that this report has been prepared at the request of Christchurch City Council and is intended to be used for their purposes only. GHD accepts no responsibility for any other party or person who relies on the information contained in this report or a specific limitations section.

### 13.2 Geotechnical Limitations

This report presents the results of a geotechnical appraisal prepared for the purpose of this commission, and for prepared solely for the use of Christchurch City Council and their advisors. The data and advice provided herein relate only to the project and structures described herein and must be reviewed by a competent geotechnical engineer before being used for any other purpose. GHD Limited (GHD) accepts no responsibility for other use of the data.

The advice tendered in this report is based on a visual geotechnical appraisal. No subsurface investigations have been conducted. An assessment of the topographical land features have been made based on this information. It is emphasised that Geotechnical conditions may vary substantially across the site from where observations have been made. Subsurface conditions, including groundwater levels can change in a limited distance or time. In evaluation of this report cognisance should be taken of the limitations of this type of investigation.

An understanding of the geotechnical site conditions depends on the integration of many pieces of information, some regional, some site specific, some structure specific and some experienced based. Hence this report should not be altered, amended or abbreviated, issued in part and issued incomplete in any way without prior checking and approval by GHD. GHD accepts no responsibility for any circumstances, which arise from the issue of the report, which have been modified in any way as outlined above.

Appendix A  
Photographs



**Photograph 1 North elevation.**



**Photograph 2 View of the toilet from the west.**



**Photograph 3 Roof truss and purlins.**



**Photograph 4 Roof truss anchored into top of wall, column adjacent.**




**Photograph 5 Purlin with rust.**

Appendix B

## Existing Drawings / Sketches

- PARTIAL FILL 15 SERIES CMU
- Ø65 TUBE OFF TOP OF MASONRY
- Ø65 COLUMN TO FOUNDATION
- — — LINE OF ROOF TRUSS

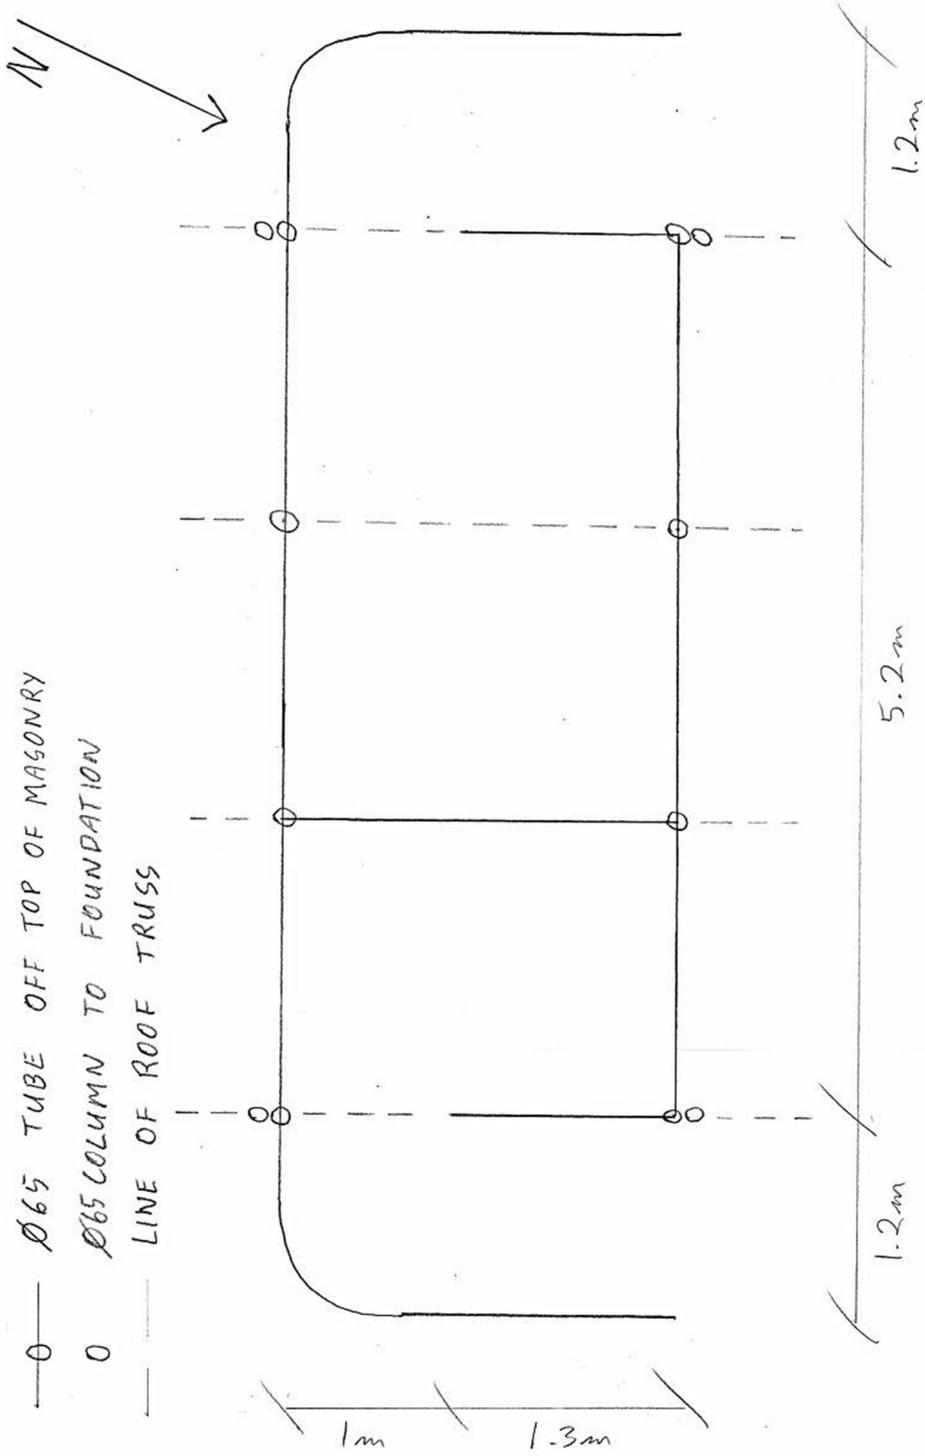

Appendix C

## CERA Building Evaluation Form

<b>Location</b>		Building Name: <u>Toilets by tennis courts, Rawhiti Domain</u>	Reviewer: <u>Stephen Lee</u>
		Unit No: <u>Street</u>	CPEng No: <u>1006840</u>
	Building Address: <u>35-37</u>	<u>Bowhill Road</u>	Company: <u>GHD</u>
	Legal Description: <u>Pt Res 1579</u>		Company project number: <u>513090228</u>
			Company phone number: <u>04 472 0799</u>
		Degrees Min Sec	Date of submission: <u>7/3/2013</u>
	GPS south: <u>43 30 10.00</u>		Inspection Date: <u>18-Jun-11</u>
	GPS east: <u>172 43 33.59</u>		Revision: <u>FINAL</u>
	Building Unique Identifier (CCC): <u>PRK_2004_BLDG_002_EQ2</u>		Is there a full report with this summary? <u>yes</u>

<b>Site</b>	Site slope: <u>flat</u>	Max retaining height (m): <u></u>
	Soil type: <u>silty sand</u>	Soil Profile (if available): <u></u>
	Site Class (to NZS1170.5): <u>D</u>	
	Proximity to waterway (m, if <100m): <u></u>	If Ground improvement on site, describe: <u></u>
	Proximity to clifftop (m, if < 100m): <u></u>	
	Proximity to cliff base (m,if <100m): <u></u>	Approx site elevation (m): <u></u>

<b>Building</b>	No. of storeys above ground: <u>1</u>	single storey = 1	Ground floor elevation (Absolute) (m): <u>3.00</u>
	Ground floor split? <u>no</u>		Ground floor elevation above ground (m): <u>0.00</u>
	Stores below ground: <u>0</u>		
	Foundation type: <u>raft slab</u>		if Foundation type is other, describe: <u></u>
	Building height (m): <u>3.40</u>	height from ground to level of uppermost seismic mass (for IEP only) (m): <u>3.4</u>	
	Floor footprint area (approx): <u>12</u>		Date of design: <u>1976-1992</u>
	Age of Building (years): <u>30</u>		
	Strengthening present? <u>no</u>		If so, when (year)? <u></u>
	Use (ground floor): <u>other (specify)</u>		And what load level (%g)? <u></u>
	Use (upper floors): <u></u>		Brief strengthening description: <u></u>
	Use notes (if required): <u>Public Toilet</u>		
	Importance level (to NZS1170.5): <u>IL2</u>		

<b>Gravity Structure</b>	Gravity System: <u>load bearing walls</u>	
	Roof: <u>steel truss</u>	truss depth, purlin type and cladding describe system: <u>65mm Dia stell tube slab on grade</u>
	Floors: <u>other (note)</u>	
	Beams: <u></u>	
	Columns: <u>structural steel</u>	typical dimensions (mm x mm) thickness (mm): <u>65mm Dia steel tube 140</u>
	Walls: <u>partially filled concrete masonry</u>	

<b>Lateral load resisting structure</b>	Lateral system along: <u>partially filled CMU</u>	<b>Note: Define along and across in detailed report!</b>	
	Ductility assumed, μ: <u>1.25</u>	enter height above at H31	note total length of wall at ground (m): <u>5.2</u>
	Period along: <u>0.40</u>		estimate or calculation? <u>estimated</u>
	Total deflection (ULS) (mm): <u></u>		estimate or calculation? <u></u>
	maximum interstorey deflection (ULS) (mm): <u></u>		estimate or calculation? <u></u>
	Lateral system across: <u>partially filled CMU</u>		note total length of wall at ground (m): <u>2.3</u>
	Ductility assumed, μ: <u>1.25</u>	enter height above at H31	estimate or calculation? <u>estimated</u>
	Period across: <u>0.40</u>		estimate or calculation? <u></u>
	Total deflection (ULS) (mm): <u></u>		estimate or calculation? <u></u>
	maximum interstorey deflection (ULS) (mm): <u></u>		

<b>Separations:</b>	north (mm): <u></u>	leave blank if not relevant
	east (mm): <u></u>	
	south (mm): <u></u>	
	west (mm): <u></u>	

<b>Non-structural elements</b>	Stairs: <u></u>	
	Wall cladding: <u></u>	
	Roof Cladding: <u>Metal</u>	describe: <u>Curved corrugated sheets</u>
	Glazing: <u></u>	
	Ceilings: <u></u>	
	Services(list): <u></u>	

<b>Available documentation</b>	Architectural: <u></u>	original designer name/date: <u></u>
	Structural: <u></u>	original designer name/date: <u></u>
	Mechanical: <u></u>	original designer name/date: <u></u>
	Electrical: <u></u>	original designer name/date: <u></u>
	Geotech report: <u></u>	original designer name/date: <u></u>

<b>Damage</b>	Site performance: <u></u>	Describe damage: <u></u>
Site: (refer DEE Table 4-2)	Settlement: <u>none observed</u>	notes (if applicable): <u></u>
	Differential settlement: <u>none observed</u>	notes (if applicable): <u></u>
	Liquefaction: <u>none apparent</u>	notes (if applicable): <u></u>
	Lateral Spread: <u>none apparent</u>	notes (if applicable): <u></u>
	Differential lateral spread: <u>none apparent</u>	notes (if applicable): <u></u>
	Ground cracks: <u>none apparent</u>	notes (if applicable): <u></u>
	Damage to area: <u>none apparent</u>	notes (if applicable): <u></u>

<b>Building:</b>	Current Placard Status: <u></u>	
Along	Damage ratio: <u>0%</u>	Describe how damage ratio arrived at: <u></u>
	Describe (summary): <u></u>	
Across	Damage ratio: <u>0%</u>	
	Describe (summary): <u></u>	
Diaphragms	Damage?: <u>no</u>	Describe: <u></u>
CSWs:	Damage?: <u>no</u>	Describe: <u></u>
Pounding:	Damage?: <u>no</u>	Describe: <u></u>
Non-structural:	Damage?: <u>no</u>	Describe: <u></u>

$$Damage\_Ratio = \frac{(\% NBS (before) - \% NBS (after))}{\% NBS (before)}$$

<b>Recommendations</b>	Level of repair/strengthening required: <u></u>	Describe: <u></u>
	Building Consent required: <u></u>	Describe: <u></u>
	Interim occupancy recommendations: <u>full occupancy</u>	Describe: <u></u>
Along	Assessed %NBS before e'quakes: <u>39%</u>	39% %NBS from IEP below
	Assessed %NBS after e'quakes: <u>39%</u>	
Across	Assessed %NBS before e'quakes: <u>39%</u>	39% %NBS from IEP below
	Assessed %NBS after e'quakes: <u>39%</u>	

If IEP not used, please detail assessment methodology:

Period of design of building (from above): 1976-1992

h<sub>n</sub> from above: 3.4m

Seismic Zone, if designed between 1965 and 1992: **B**

not required for this age of building  
not required for this age of building

	along	across
Period (from above):	0.4	0.4
(%NBS) <sub>nom</sub> from Fig 3.3:	16.5%	16.5%

Note:1 for specifically design public buildings, to the code of the day: pre-1965 = 1.25; 1965-1976, Zone A =1.33; 1965-1976, Zone B = 1.2; all else 1.0	1.00
Note 2: for RC buildings designed between 1976-1984, use 1.2	1.0
Note 3: for buildings designed prior to 1935 use 0.8, except in Wellington (1.0)	1.0

	along	across
Final (%NBS) <sub>nom</sub> :	17%	17%

**2.2 Near Fault Scaling Factor**

Near Fault scaling factor, from NZS1170.5, cl 3.1.6: 1.00

	along	across
Near Fault scaling factor (1/N(T,D), <b>Factor A</b> ):	1	1

**2.3 Hazard Scaling Factor**

Hazard factor Z for site from AS1170.5, Table 3.3:	0.30
Z <sub>1992</sub> , from NZS4203:1992	
Hazard scaling factor, <b>Factor B</b> :	3.333333333

**2.4 Return Period Scaling Factor**

Building Importance level (from above):	2
Return Period Scaling factor from Table 3.1, <b>Factor C</b> :	1.00

**2.5 Ductility Scaling Factor**

Assessed ductility (less than max in Table 3.2)	along	across
Ductility scaling factor: =1 from 1976 onwards; or =κ <sub>μ</sub> , if pre-1976, from Table 3.3:	1.25	1.25
	1.00	1.00

Ductility Scaling Factor, <b>Factor D</b> :	1.00	1.00
---	------	------

**2.6 Structural Performance Scaling Factor:**

Sp:	1.000	1.000
-----	-------	-------

Structural Performance Scaling Factor <b>Factor E</b> :	1	1
---	---	---

**2.7 Baseline %NBS, (NBS%)<sub>b</sub> = (%NBS)<sub>nom</sub> x A x B x C x D x E**

%NBS <sub>b</sub> :	55%	55%
---------------------	-----	-----

Global Critical Structural Weaknesses: (refer to NZSEE IEP Table 3.4)

3.1. Plan Irregularity, factor A: insignificant 1

3.2. Vertical irregularity, Factor B: insignificant 1

3.3. Short columns, Factor C: insignificant 1

3.4. Pounding potential  
Pounding effect D1, from Table to right 1.0  
Height Difference effect D2, from Table to right 1.0

Therefore, Factor D: 1

3.5. Site Characteristics insignificant 1

Table for selection of D1	Severe	Significant	Insignificant/none
Separation	0<sep<.005H	.005<sep<.01H	Sep>.01H
Alignment of floors within 20% of H	0.7	0.8	1
Alignment of floors not within 20% of H	0.4	0.7	0.8

Table for Selection of D2	Severe	Significant	Insignificant/none
Separation	0<sep<.005H	.005<sep<.01H	Sep>.01H
Height difference > 4 storeys	0.4	0.7	1
Height difference 2 to 4 storeys	0.7	0.9	1
Height difference < 2 storeys	1	1	1

**3.6. Other factors, Factor F**

For ≤ 3 storeys, max value =2.5, otherwise max valule =1.5, no minimum	Along	Across
Rationale for choice of F factor, if not 1	0.7	0.7
	Cantilever masonry panels	Cantilever masonry panels

Detail Critical Structural Weaknesses: (refer to DEE Procedure section 6)

List any: Refer also section 6.3.1 of DEE for discussion of F factor modification for other critical structural weaknesses

**3.7. Overall Performance Achievement ratio (PAR)**

	0.70	0.70
--	------	------

**4.3 PAR x (%NBS)<sub>b</sub>:**

PAR x Baselline %NBS:	39%	39%
-----------------------	-----	-----

**4.4 Percentage New Building Standard (%NBS), (before)**

	39%
--	-----

**GHD**

Level 11, Guardian Trust House  
15 Willeston street, Wellington 6011  
T: 64 4 472 0799 F: 64 4 472 0833 E: wgtnmail@ghd.com

**© GHD Limited 2012**

This document is and shall remain the property of GHD Limited. The document may only be used for the purpose for which it was commissioned and in accordance with the Terms of Engagement for the commission. Unauthorised use of this document in any form whatsoever is prohibited.

**Document Status**

Rev No.	Author	Reviewer		Approved for Issue		
		Name	Signature	Name	Signature	Date
Draft	Paul Clarke	Alex Baylis		Stephen Lee		14/06/2012
FINAL	Paul Clarke	Alex Baylis		Stephen Lee		07/03/2013