


Flow data

The table shows the quantity of wastewater treated each day during the last month. Figure 1 shows the daily quantity of wastewater treated back to 2011.

Date	Flow (m ³ /day)	Consent limit (m ³ /day)
1/01/2021	380	2500
2/01/2021	330	2500
3/01/2021	362	2500
4/01/2021	367	2500
5/01/2021	313	2500
6/01/2021	335	2500
7/01/2021	315	2500
8/01/2021	312	2500
9/01/2021	352	2500
10/01/2021	343	2500
11/01/2021	296	2500
12/01/2021	297	2500
13/01/2021	327	2500
14/01/2021	305	2500
15/01/2021	301	2500
16/01/2021	331	2500
17/01/2021	388	2500
18/01/2021	331	2500
19/01/2021	311	2500
20/01/2021	314	2500
21/01/2021	291	2500
22/01/2021	320	2500
23/01/2021	317	2500
24/01/2021	347	2500
25/01/2021	312	2500
26/01/2021	320	2500
27/01/2021	296	2500
28/01/2021	393	2500
29/01/2021	304	2500
30/01/2021	335	2500
31/01/2021	347	2500

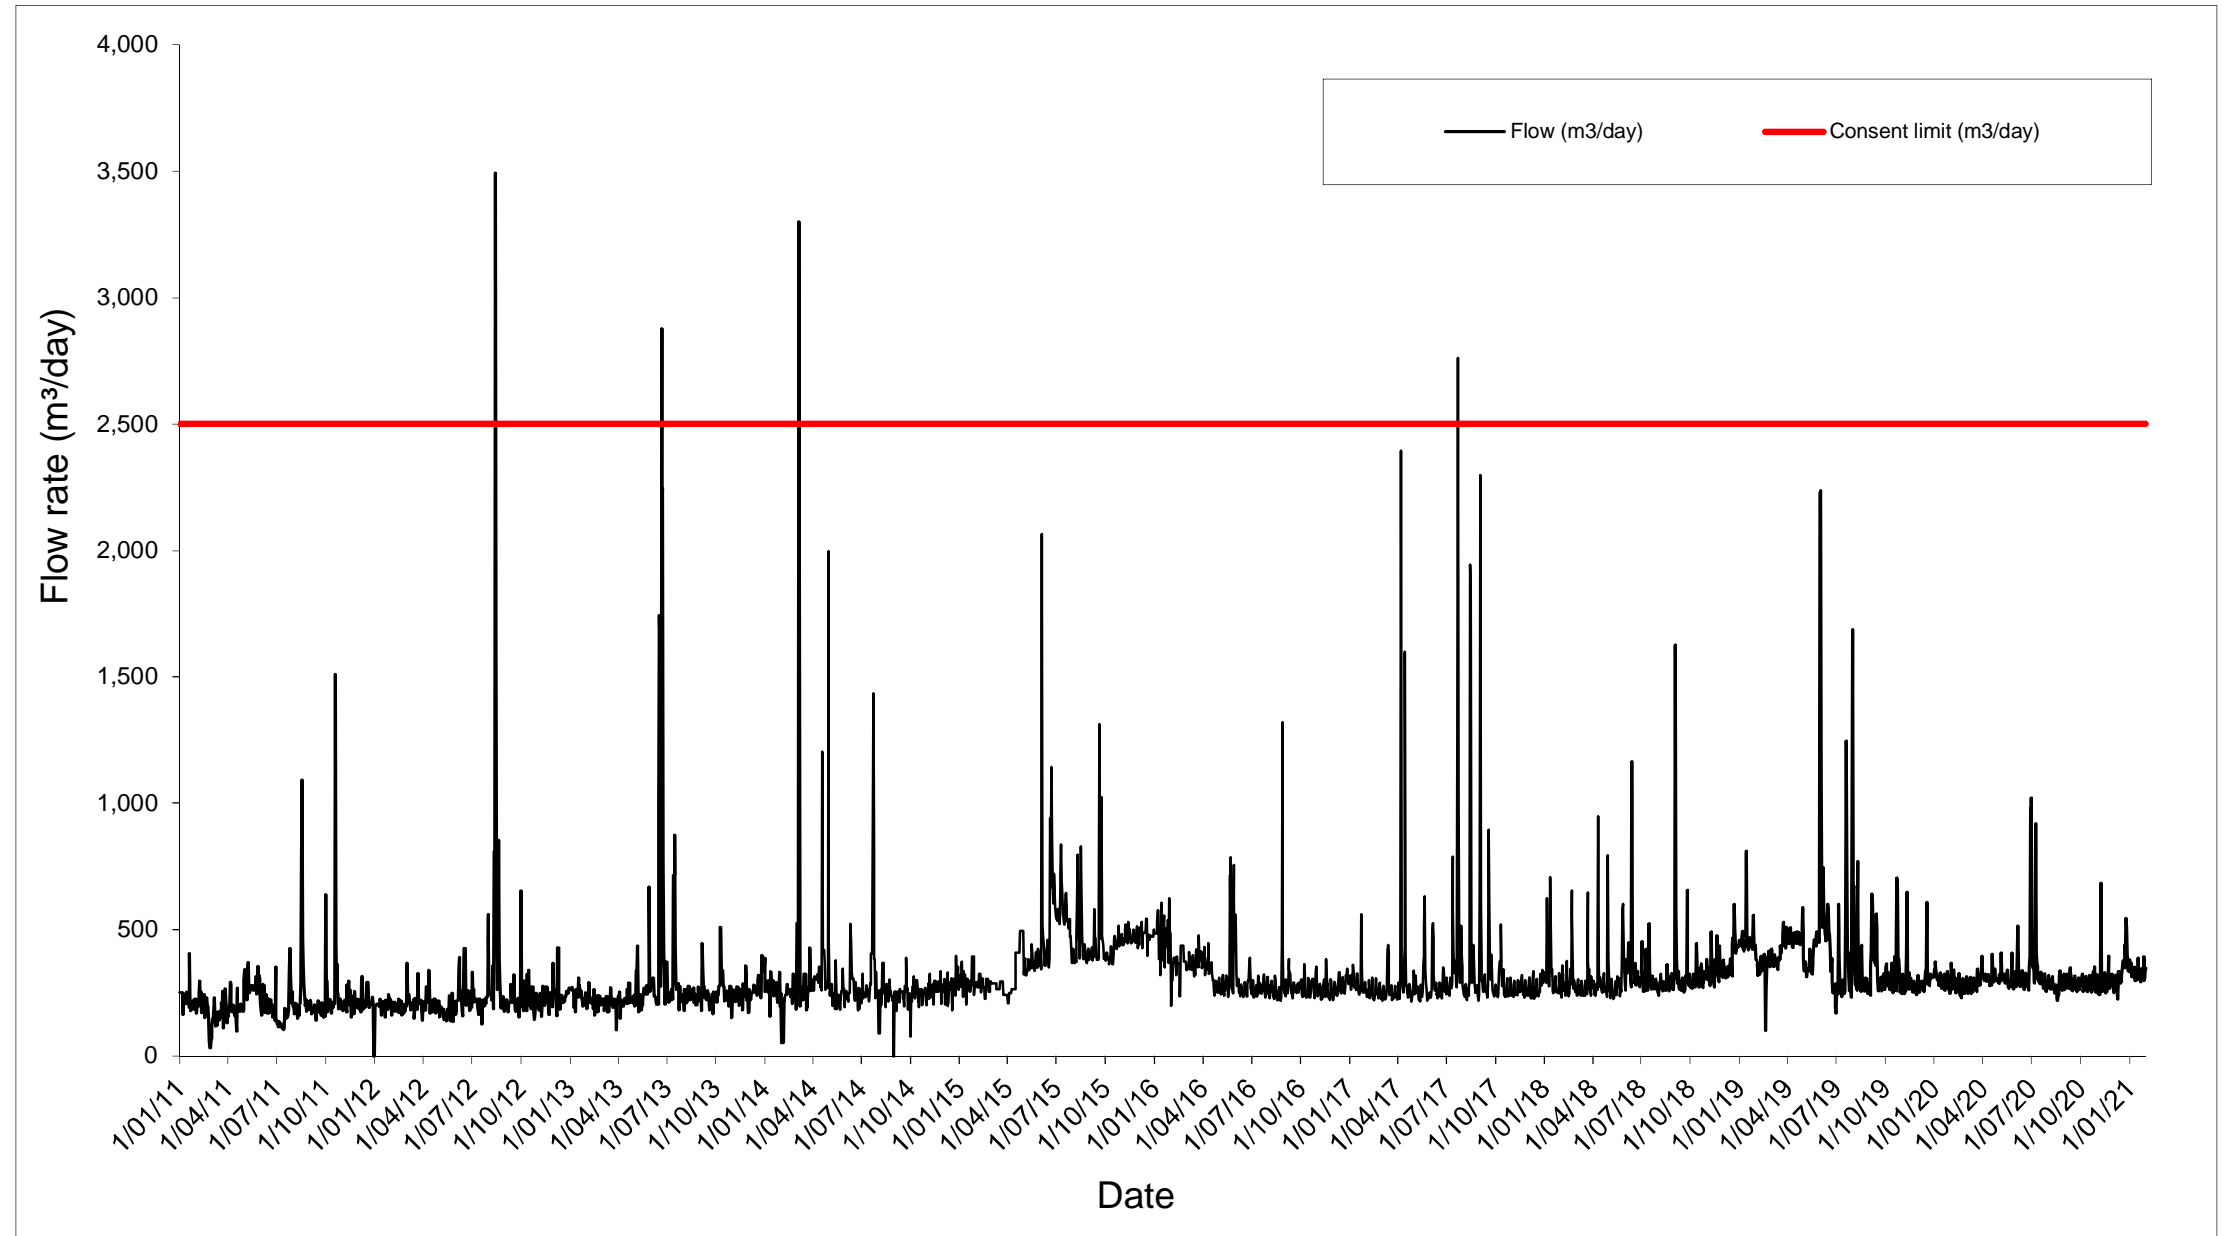

Legend
m³ cubic metres

Figure 1: The daily quantity of treated water from 2012 to present at Diamond Harbour wastewater treatment plant.