


## Flow data

Date	Flow (m3/day)	Consent limit (m3/day)
1/02/2021	300	1500
2/02/2021	258	1500
3/02/2021	244	1500
4/02/2021	222	1500
5/02/2021	314	1500
6/02/2021	460	1500
7/02/2021	569	1500
8/02/2021	487	1500
9/02/2021	273	1500
10/02/2021	378	1500
11/02/2021	302	1500
12/02/2021	300	1500
13/02/2021	342	1500
14/02/2021	345	1500
15/02/2021	312	1500
16/02/2021	348	1500
17/02/2021	315	1500
18/02/2021	327	1500
19/02/2021	368	1500
20/02/2021	491	1500
21/02/2021	467	1500
22/02/2021	362	1500
23/02/2021	301	1500
24/02/2021	294	1500
25/02/2021	294	1500
26/02/2021	327	1500
27/02/2021	394	1500
28/02/2021	373	1500

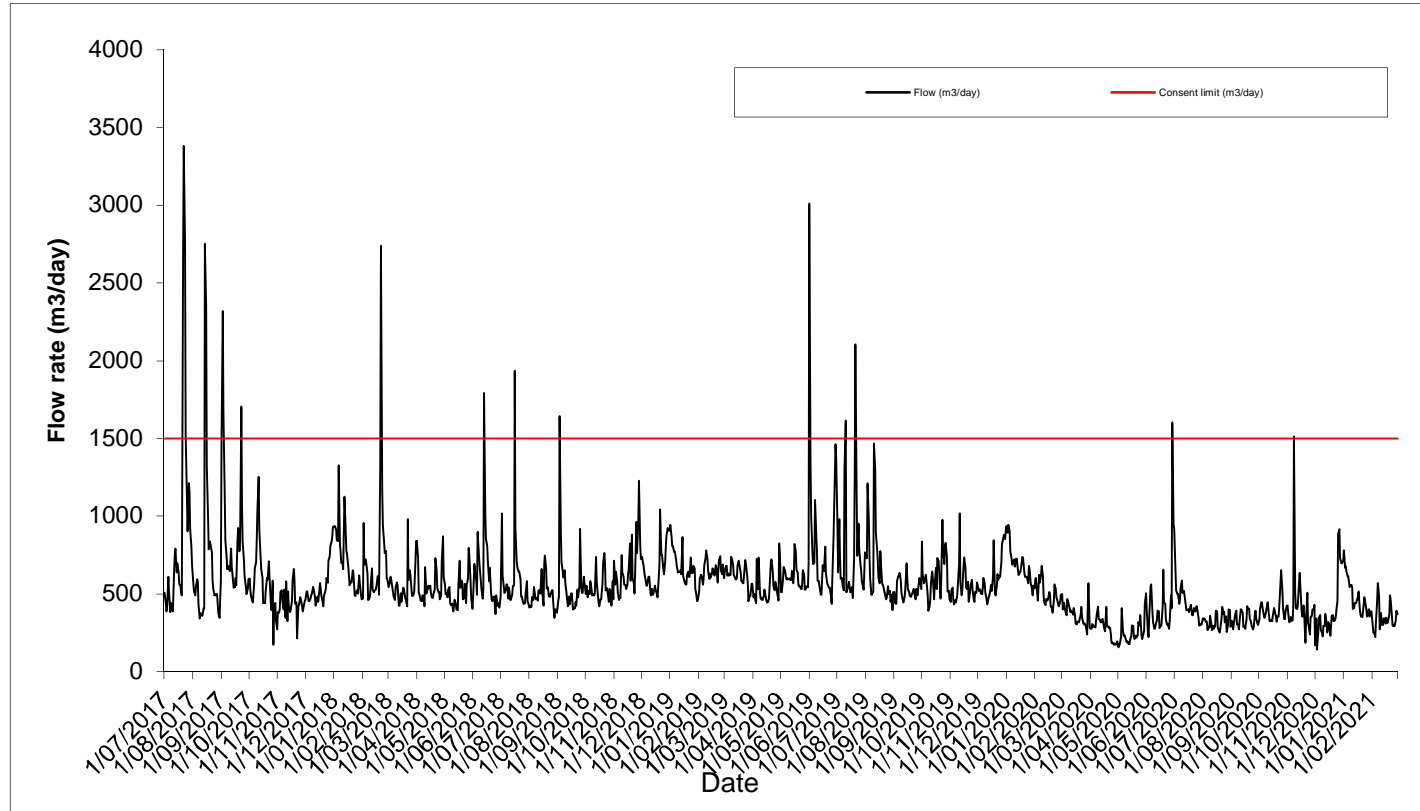

Legend  
m<sup>3</sup>

Figure 1: The daily quantity of treated water from 2017 to present at Akaroa wastewater treatment plant.  
cubic metres