




We discharge treated wastewater three kilometres offshore and take samples of ocean water from New Brighton Beach surf club, South New Brighton beach and Sumner beach. The consent limits are 43 faecal coliforms per 100 millilitres and 280 enterococci per 100 millilitres of water.

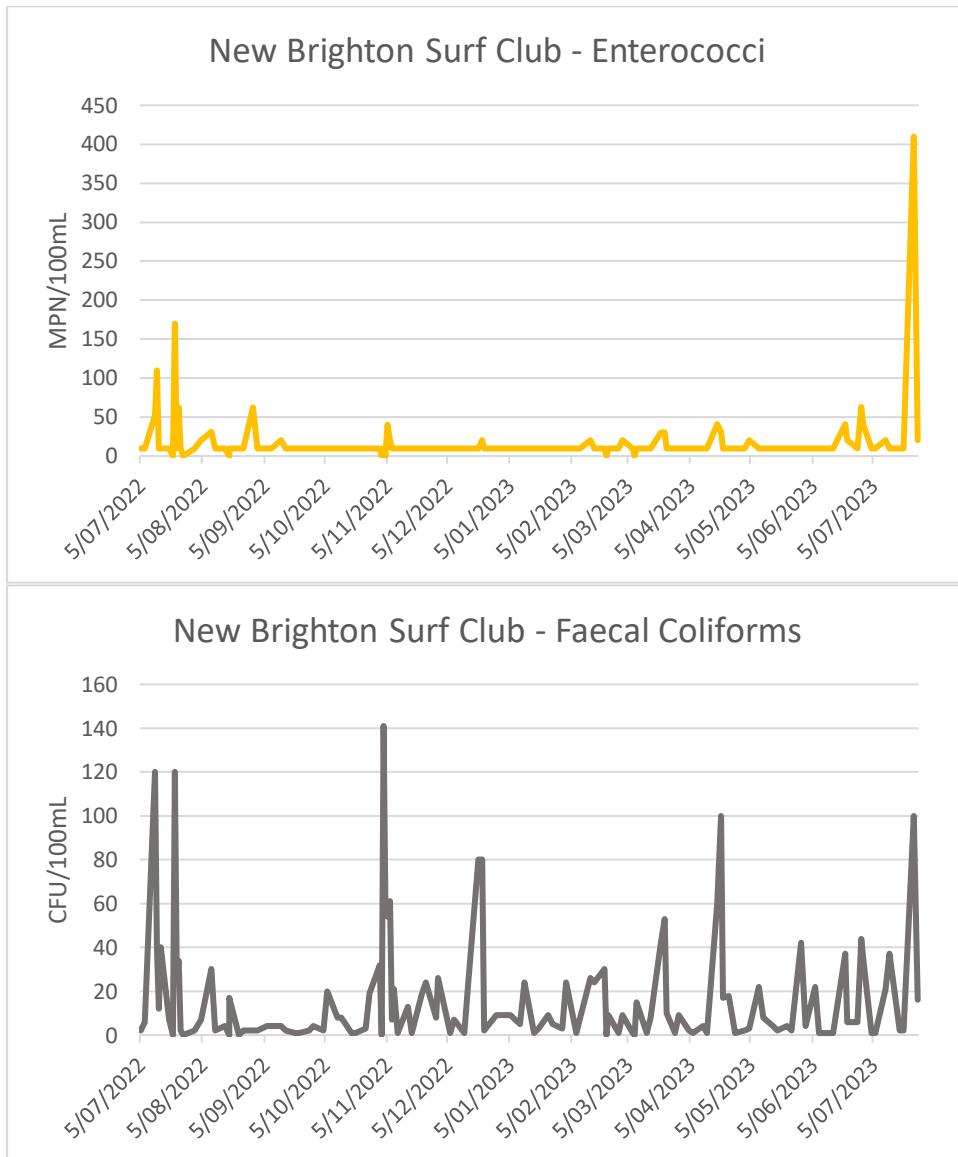


Sumner Beach - Enterococci

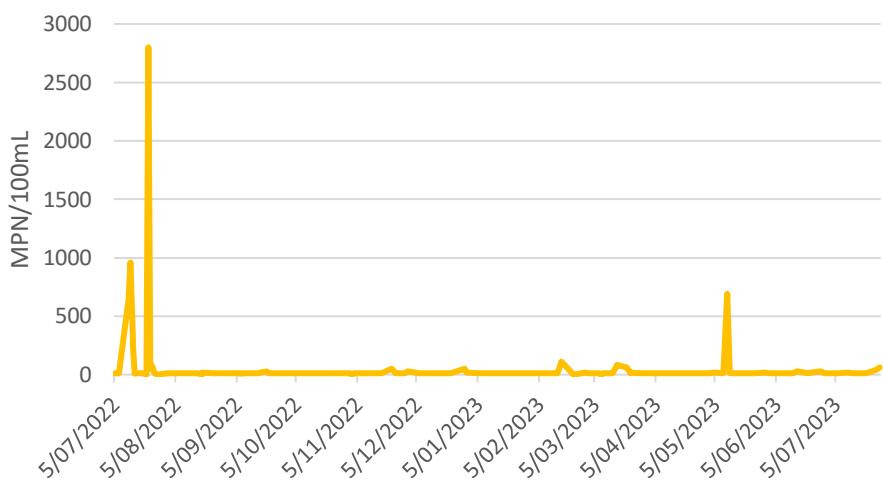


Sumner Beach - Faecal Coliforms

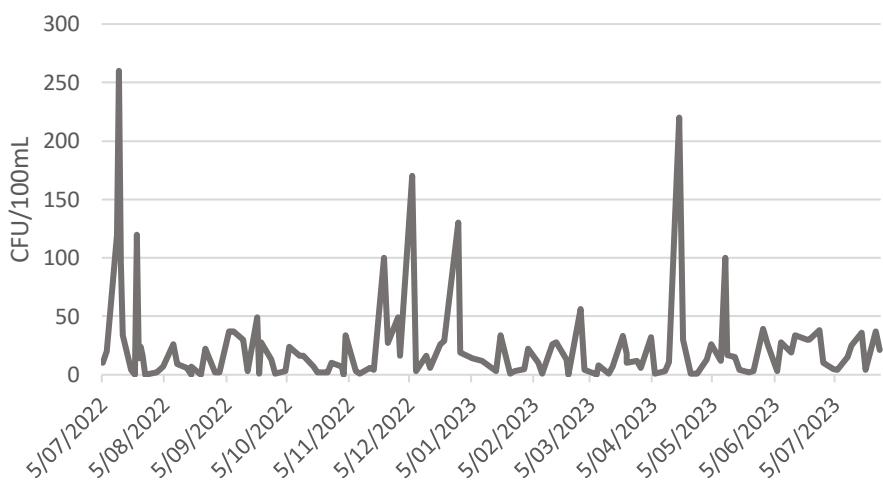

South New Brighton - Enterococci

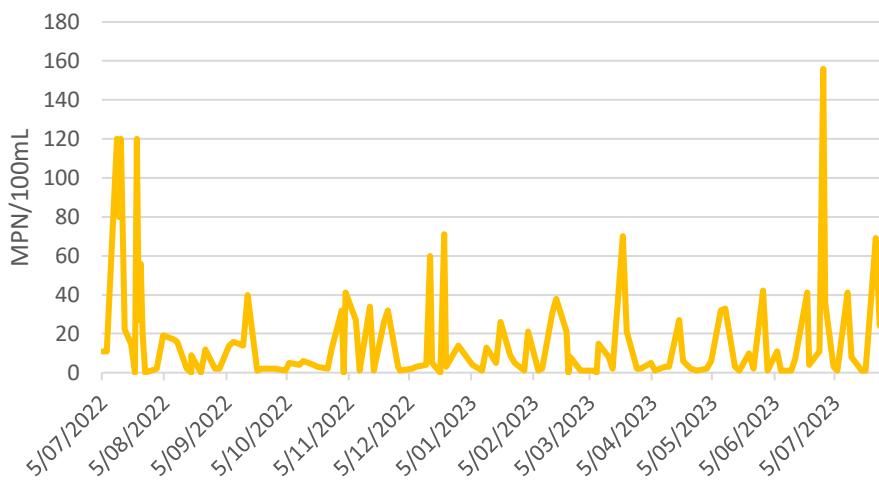

South New Brighton Beach - Faecal Coliforms

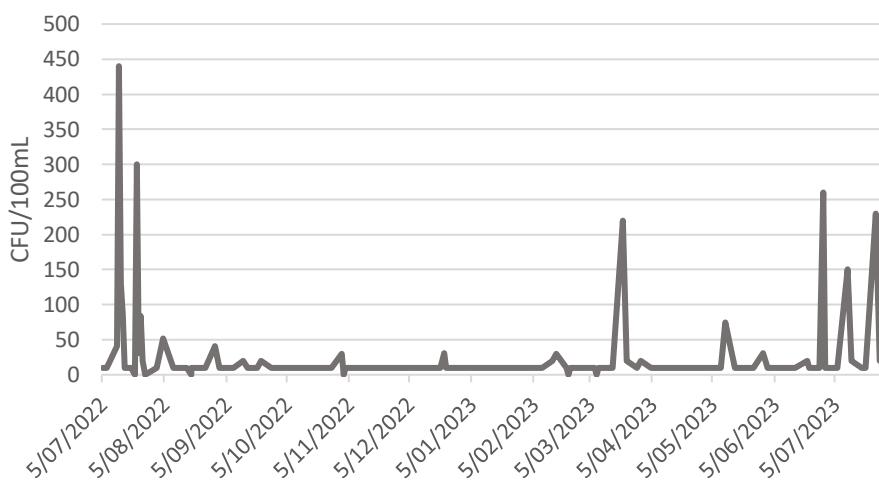

Updated 7/8/2023.